


SIDE ELEVATION

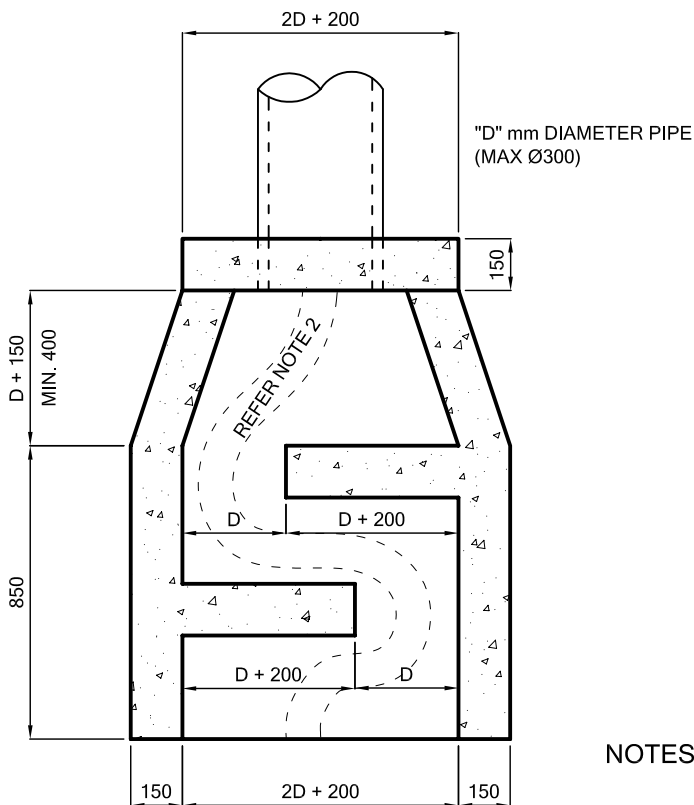

PLAN

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS STATED OTHERWISE
2. CONCRETE SHALL BE 25MPa MINIMUM STRENGTH
3. FORM LOW FLOW CHANNEL IN FLOOR OF DISSIPATOR

AMENDMENTS	DATE		CONCRETE ENDWALL & ENERGY DISSIPATOR (MAX PIPE Ø300)	DRAWN BY: WDA
ORIGINAL - WDA	8/97			DATE: JAN '07
UPDATED NOTES & DETAILS	1/07			SCALE: N.T.S.
		MANAGER CIVIL DEVELOPMENT SERVICES		DRAWING NO.: SD / E1